



# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，  
不得单独使用  
This translated document  
does not have legal validity and  
cannot be used in isolation

**CERTIFICATE NO.:** 2024010305675952

**NAME AND ADDRESS OF THE APPLICANT**

K.A. Schmersal GmbH & Co. KG  
Moeddinghofe 30, D-42279 Wuppertal, Germany

**NAME AND ADDRESS OF THE MANUFACTURER**

K.A. Schmersal GmbH & Co. KG  
Moeddinghofe 30, D-42279 Wuppertal, Germany

**NAME AND LOCATION OF THE FACTORY**

Schmersal India Pvt. Ltd.  
G-7/1, MIDC; Ranjangaon, Tal. Shirur, Dist. Pune – 412 220 Maharashtra, India

**PRODUCT NAME, MODEL AND SPECIFICATION**

Limit Switch  
T/M 015,016,017; See the Appendix

**STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS**

GB/T 14048.5-2017

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification (REFNO. CNCA-C03-02:2024).

**Valid from:** Aug.14,2024

**Valid until:** Aug.13,2029

The certificate information and validity could be checked by scanning the QR code below or logging in to the website of the issuing authority, or on the website of the CNCA ([www.cnca.gov.cn](http://www.cnca.gov.cn)).



SIGNATURE:

谢肇煦



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.





# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，  
不得单独使用  
This translated document  
does not have legal validity and  
cannot be used in isolation

CERTIFICATE NO. : 2024010305675952

Appendix : Page 1 of 3

T/M 015,016,017

Ui:2NO,2NC,3NO,3NC:400V ;

1NO1NC,1NO2NC,2NO1NC,2NO2NC,1NO3NC,3NO1NC:500V;

AC-15:Ue/Ie: AC400V/2.5A(M Snap action ), AC400V/4A(T Slow action);


Ith: 10A; AC-15; IP65(Y type), IP54(X type)

Explanation of / type):

015 series 2 contacts, basic switch size 67x75x43 without actuator

016 series 3 contacts, basic switch size 67x152x43 without actuator

017 series 4 contacts, basic switch size 67x130x43 without actuator

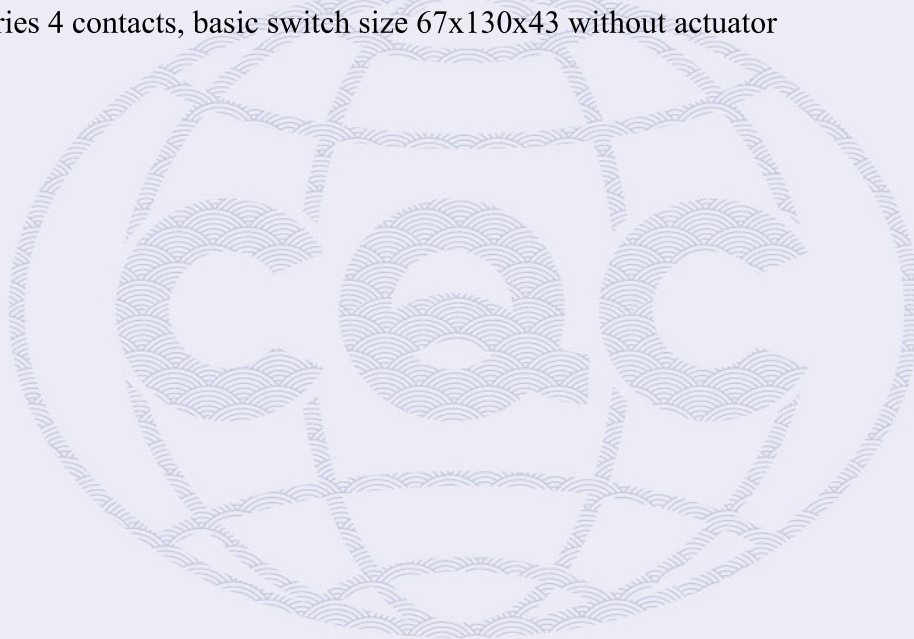

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，  
不得单独使用  
This translated document  
does not have legal validity and  
cannot be used in isolation

CERTIFICATE NO. : 2024010305675952

Appendix : Page 2 of 3

Type Designation: (1)(2) (3) -(4) (5)-(6)-(7)-(8)-(9)				
Nr.	Option	Description	描述	Remark 备注
(1)	T	Slow action	缓动	
	M	Snap action	速动	
(2)	S	Plunger S	直杆 S	
	2S	Telescopic plunger 2S	加长直杆 2S	
	K	Offset roller lever K	滚轮偏移 K	
	2K	Rocking offset roller lever 2K	滚轮摇臂摇摆偏差 2K	
	3K	Angle roller lever 3K	滚轮摇臂 3K	
	VH	Roller lever H	滚轮摇臂 H	
	V2H	Leaf-spring lever 2H	弹簧杆 2H	
	V3H	Roller lever 3H	滚轮摇臂 3H	
	V4H	Spring rod lever on shaft 4H	轴上的弹簧杆 4H	
	V6H	Leaf-spring lever 6H	弹簧杆 6H	
	V7H	Roller lever 7H	滚轮摇臂 7H	
	V8H	Roller lever 8H	滚轮摇臂 8H	
	V9H	Rod lever 9H	长杆摇臂 9H	
	V10H	Rod lever 10H	长杆摇臂 10H	
	3V.	With hex shaft 12mm	带六角轴 12mm	
	V. (="V dot")	Switch without actuator; to be completed with one of the actuators H/2H/3H...10H	开关无操动机构, 带以上提到的 任一操动件将是完整的	

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



# CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，  
不得单独使用  
This translated document  
does not have legal validity and  
cannot be used in isolation

CERTIFICATE NO. : 2024010305675952

Appendix : Page 3 of 3

(4)	11	1 NO contact / 1 NC contact	1 常开, 1 常闭触点		
	02	2 NC contacts	2 常闭触点	Ui = 400V	
	20	2 Normally open contacts	2 常开触点	Ui = 400V	
	12	1 NO contact / 2 NC contacts	1 常开, 2 常闭触点		
	21	2 Normally open contacts, 1 Normally closed contact	2 常开, 1 常闭触点		
	03	3 NC contacts	3 常闭触点	Ui = 400V	
	30	3 Normally open contacts	3 常开触点	Ui = 400V	
	22	2 NO contacts / 2 NC contacts	2 常开, 2 常闭触点		
	13	1 NO contact / 3 NC contacts	1 常开, 3 常闭触点		
	31	3 NO contacts / 1 NC contact	3 常开, 1 常闭触点		
	(5)	X	IP protection 54	IP 54	
		Y	IP protection 65	IP 65	

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心  
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.